



NOTES:


1. Valve box and cover shall be ASTM Class 30 grey iron.
2. Use with matching gate valve box extension pipe.
3. See utility cover adjustment, Standard Drawing 23.  
Use TYLER ® Series 6855, East Jordan Series 8555, or approved equal.
4. Compact hot mix asphalt patch in no greater than 3-inch lifts.

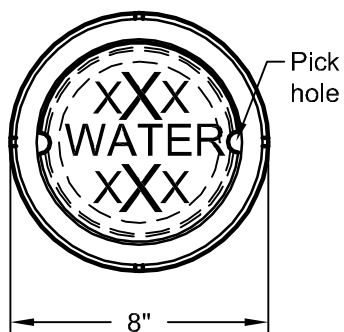

PLAN

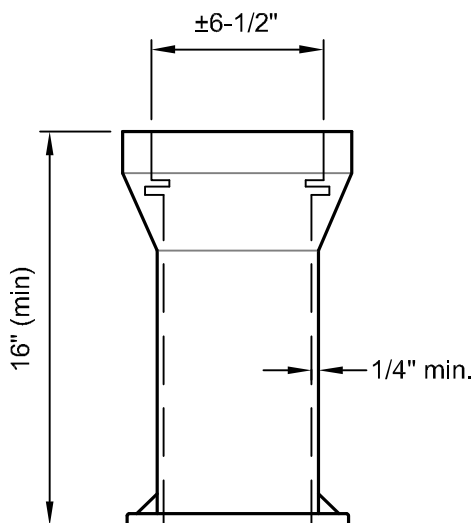

SIDE VIEW

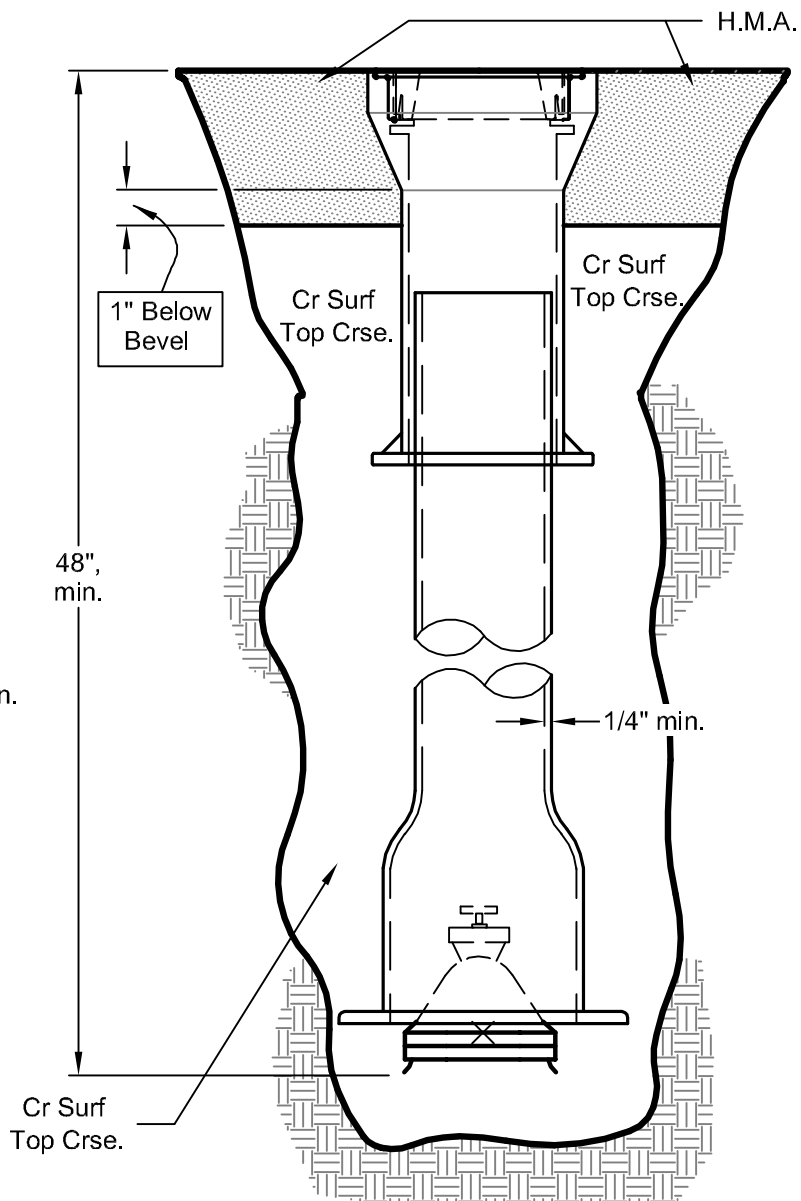

TYPICAL  
INSTALLATION

AutoCAD: Waterline Valve Box & Cover

dwc 3-00

ZGS

# VALVE BOX AND COVER

PAGE NO:

11

CITY OF PULLMAN  
ENGINEERING DIVISION

ADOPTED: April 8, 2008